


Serial Out
Serial In


→ Connection to next unit.
← Connection from prev. unit.

Bus connection for serial connection up to 35 pcs. control units.

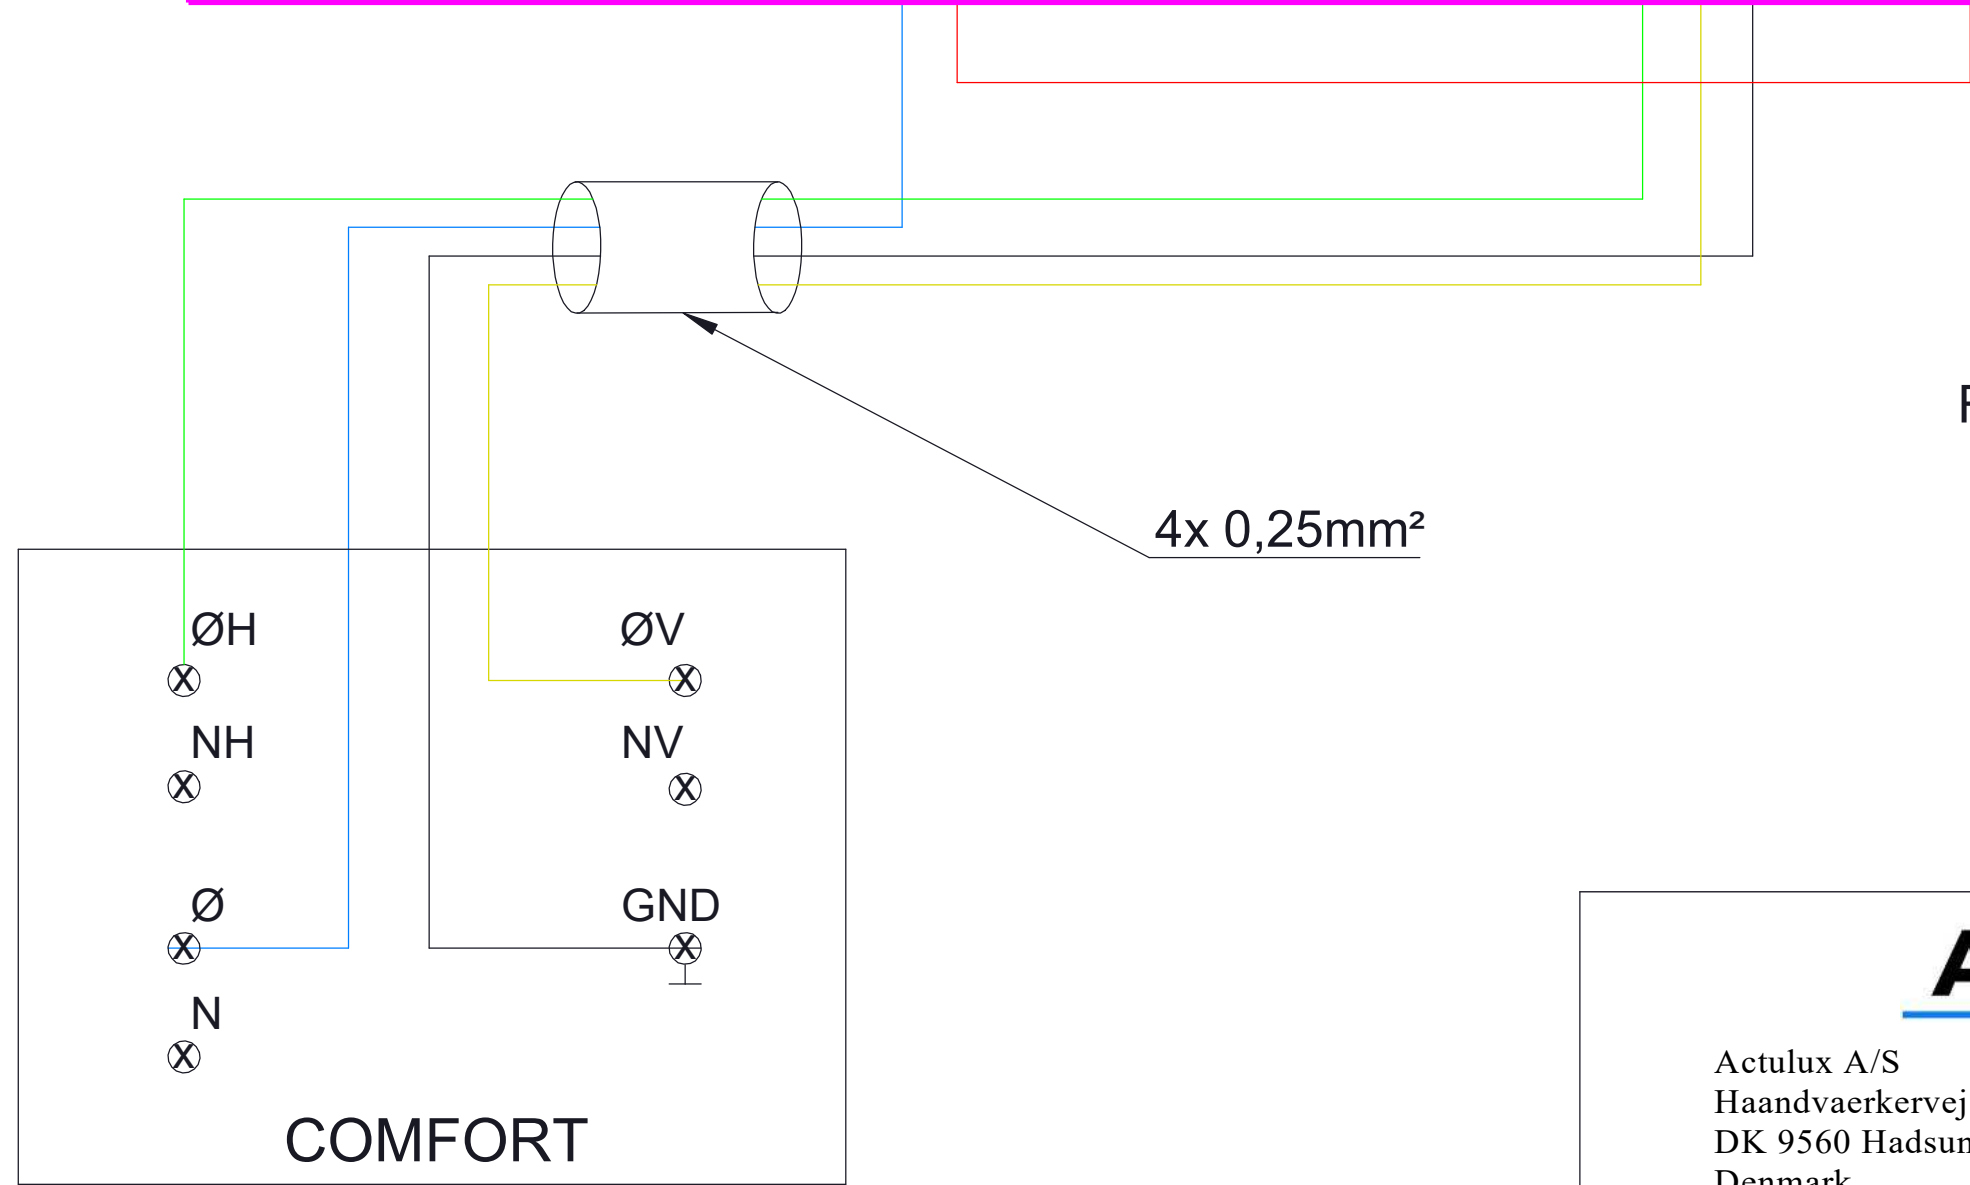

Remember to set DIP5 in SVM

#111943



Actulux

Actulux A/S Haandvaerkevej 2 DK 9560 Hadsund Denmark	Phone int.: +45 98 57 40 90 Fax int.: +45 96 15 28 00 e-mail: info@actulux.com www.actulux.com
---	---

DRAWN BY: ML	DATE: 15-10-18	SIZE: A4	SHEET: 2 OF 2	SCALE: 1:1
TITLE: Diagram for comf. switch		DWG NO.: 111975		REV: A